

TFV Fire Valves
Comply with:
OFTEC OFS E101

OFCERT Nos.
14102/1/2



T&D THORNE &
DERRICK UK

Tel: +44 (0)191 490 1547

Fax: +44 (0)191 477 5371

Email: northersales@thorneandderrick.co.uk

Website: www.heatracing.co.uk

www.thorneandderrick.co.uk



Manufactured by FuelStop, Woodley Park
Estate, 59-69 Reading Road, Woodley,
Reading, Berkshire RG5 3AN

Formerly
manufactured by

FEL Valves



Installation &
Maintenance
Instructions

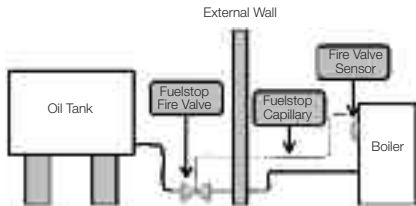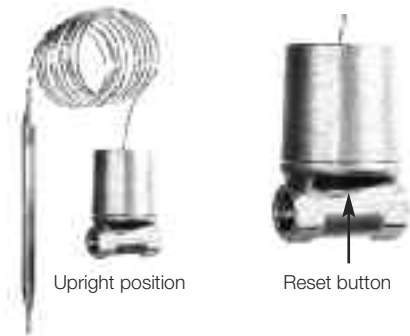

Test in accordance with correct standards.
 Fire valve testing kits are available from merchants.

Installation

- Position the valve in accordance with BS 5410 (Part 2) and any other current legislation or guidelines.
- Install the valve in an upright position. Unroll the capillary to prevent twisting and fix the phial inside the appliance casing at a point recommended by the appliance manufacturer. Where the burner is outside the casing, the phial should be fixed between 600 and 100mm directly above the burner.
- Support the valve hexagon when tightening tube nuts. **DO NOT HOLD THE VALVE HEAD, DO NOT OVERTIGHTEN THE VALVE CONNECTIONS.**
- Support the capillary along its length to prevent abrasion or damage and neatly coil any spare capillary to a minimum diameter of 80mm.
- TFV Fire valves are factory calibrated, there are **NO** serviceable parts, do not attempt to dismantle.